



PROTECTION RELAYS

MC2-30M

Motor protection relay

General Characteristics

MC2 is the new generation of Microelettrica Scientifica's entry level protection relays.

Complete motor protection relay designed for the protection and active security of medium and large size induction motor.

The relay also computes the positive and negative sequence components of system. The earth current input circuit includes a 3rd harmonic active filter.

The technical specifications reported are not binding and they should be agreed in the related contract.

Protective Functions

- F37 : No-Load Running
- F46 : Current Unbalance
- F47 : Phase sequence or phase-balance voltage (Negative sequence)
- F48 : Starting Control
- F49 : Thermal Image
- F50/51 : Overcurrent
- F51LR : Locked Rotor
- F64 : Earth Fault
- F66 : Control of n° of starting
- F74 : Trip circuit supervision
- Breaker failure protection
- Reduced Voltage Starting Control

Measurements

- Real Time Measurements (IA - IB - IC - Io)
- Maximum Demand and Inrush Recording (IA - IB - IC - Io)
- Trip Recording



MICROELETTRICA

Control

- Two complete setting programs switchable locally or remotely
- Time tagged multiple event recording and journal (500 events)
- Oscillographic wave form capture up to 40 sec.
- Complete autodiagnostic program
- Blocking Outputs and Blockings Inputs for pilot wire
- file system - Mass storage device
- Oscillo available also in comtrade format

Technical Characteristics

- 8 Programmable Output Relays
- 8 Programmable Digital Inputs
- Hi-resolution graphic display (240*128)
- 10 Programmable Leds
- 6 Programmable push button

Communications

- RS485 Serial communication port on rear side
- USB communication port on front panel
- Modbus RTU / IEC870-5-103 Communication protocol

Software

- MCom2 Program interface for device management

Power Supply Ratings

- Type 1 : 24V(-20%)/110V(+15%)a.c. - 24V(-20%)/125V(+20%)d.c.
- Type 2 : 80V(-20%)/220V(+15%)a.c. - 90V(-20%)/250V(+20%)d.c.


Execution

- Plastic Enclosure
- IP44 degree of protection


Programmable Input Quantities		
Fn = System frequency	(50 ÷ 60) Hz	
In = Rated primary current of phase CTs	(0 ÷ 9999)A	step 1A
On = Rated primary current of earth fault detection CT	(0 ÷ 9999)A	step 1A
F49 : Thermal Image		
Function enabling	No - Yes	
Operation Mode	I1.I2 / IMax	
Temperature prealarm	Tal = (10 ÷ 100)%Tn	step 1%
Temperature reset	Tres = (10 ÷ 100)%Tn	step 1%
Continuous admissible current	Is = (0.5 ÷ 1.5)In	step 0.01In
Warming-up time constant of the load	To = (1 ÷ 10)	step 1
F50/51 (1I>): 1st Overcurrent Element		
Function enabling	No - Yes	
Time current curves	f(t) = Indep.Definite Time (D), IEC (A/B/C), IEEE (MI/VI/I/EI/SI)	
Operation level	Is = (0.1 ÷ 4)In	step 0.01In
Independent time delay	ts = (0.02 ÷ 100)s	step 0.01s
F50/51 (2I>): 2nd Overcurrent Element		
Function enabling	No - Yes	
Automatic doubling of trip level on inrush	Enable / Disable	
Operation level	Is = (0.1 ÷ 40)In	step 0.01In
Independent time delay	ts = (0.02 ÷ 100)s	step 0.01s
F50/51 (3I>): 3rd Overcurrent Element		
Function enabling	No - Yes	
Automatic doubling of trip level on inrush	Enable / Disable	
Operation level	Is = (0.1 ÷ 40)In	step 0.01In
Independent time delay	ts = (0.02 ÷ 100)s	step 0.01s
F64 (1Io>): 1st Earth Fault Element		
Function enabling	No - Yes	
Time current curves	f(t) = Indep.Definite Time (D), IEC (A/B/C), IEEE (MI/VI/I/EI/SI)	
Operation level	Is = (0.01 ÷ 4)On	step 0.01On
Independent time delay	ts = (0.02 ÷ 100)s	step 0.01s

F64 (2Io>): 2nd Earth Fault Element		
Function enabling	No - Yes	
Operation level	$I_s = (0.01 \div 9.99)I_n$	step 0.01 I_n
Independent time delay	$t_s = (0.02 \div 100)s$	step 0.01 s
F64 (3Io>): 3rd Earth Fault Element		
Function enabling	No - Yes	
Operation level	$I_s = (0.01 \div 9.99)I_n$	step 0.01 I_n
Independent time delay	$t_s = (0.02 \div 100)s$	step 0.01 s
F46 (1Is>): 1st Current Unbalance Element		
Function enabling	No - Yes	
Time current curves	$f(t) = \text{Indep. Definite Time (D), IEC (A/B/C), IEEE (MI/VI/I/EI/SI)}$	
Operation level	$I_s = (0.1 \div 4)I_n$	step 0.01 I_n
Independent time delay	$t_s = (0.02 \div 100)s$	step 0.01 s
F46 (2Is>): 2nd Current Unbalance Element		
Function enabling	No - Yes	
Operation level	$I_s = (0.1 \div 4)I_n$	step 0.01 I_n
Independent time delay	$t_s = (0.02 \div 100)s$	step 0.01 s
F51LR - (LR) Locked Rotor		
Function enabling	No - Yes	
Setting range	$I_{LR} = (1 \div 5)I_n$	step 0.1 I_n
Trip time delay	$t_{LR} = (1 \div 120)s$	step 1 s
F66 (StNo) - Limitation of N° of Startings		
Function enabling	No - Yes	
Numbers of starting	$StNo = (1 \div 60)$	step 1
Time interval for counting of StNo	$t_{StNo} = (60 \div 3600)s$	step 1 s
Reset time after trip	$t_{Bst} = (60 \div 3600)s$	step 1 s
F37 - (I<) No-Load Running		
Function enabling	No - Yes	
Setting Range	$I_{<} = (0.15 \div 1)I_n$	step 0.01 I_n
Trip time delay	$t_{I<} = (0.1 \div 90)s$	step 0.01 s
StSeq - Starting Sequence Control		
Function enabling	No - Yes	
Setting Range	$I_{Tr} = (0.1 \div 1)I_n$	step 0.1 I_n
Trip time delay	$t_{Tr} = (0.5 \div 50)s$	step 0.1 s
Motor Starts		
Setting Range (Min. level for motor ON)	$I_s = (0.05 \div 1)I_n$	step 0.01 I_n
Motor start filter time	$t_{fSt} = (0.02 \div 1)s$	step 0.01 s
Motor Starting time	$t_{St} = (10 \div 120)s$	step 0.01 s
Breaker Failure Element		
Alarm time delay	$t_{BF} = (0.05 \div 0.75)s$	step 0.01 s
Trip Circuit Supervision Element		
Function enabling	No - Yes	
Independent time delay	$t_s = (0.1 \div 100)s$	step 0.01 s
Trip circuit voltage	$= (24 \div 250)V_{dc}$	step 0.1 s

Connection Diagram

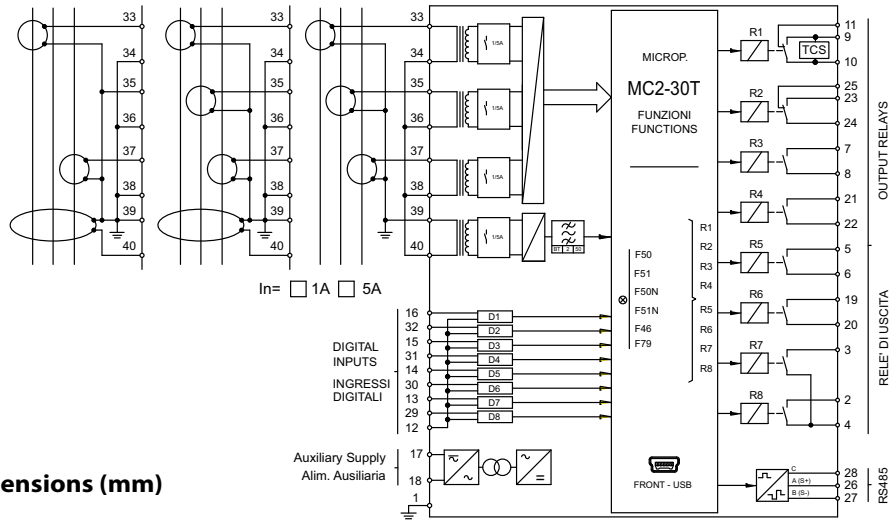

Overall Dimensions (mm)

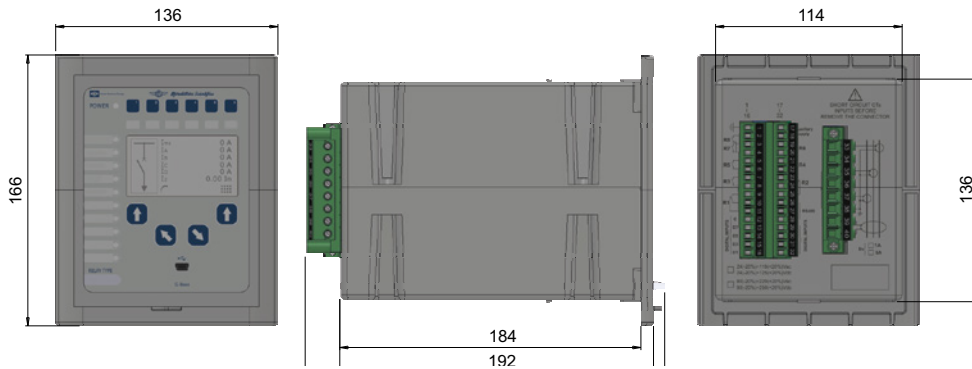

Typical Characteristics

Accuracy at reference value of influencing factors	2% In - 0.2% On	for measurements
	2% + (to = 20 ÷ 30ms @ 2xIs)	for times
Rated Current	In = 1A/5A - On = 1A/5A	
Current Overload	500 A for 1 sec; 20 A continuous	
Burden on current input	0.1 VA at In = 1A; 0.3 VA at In = 5A	
Average power supply consumption	≤ 7 VA	
Output relays	rating 6 A; Vn = 250V A.C. resistive switching = 1500W (400V max)	
	make = 30 A (peak) 0.5 sec.,	
	break = 0.3 A, 110 Vcc, L/R = 40 ms (100.000 op.)	

Order Code - Example

MC2-30M	1	2	1
	Power Supply	Phase Rated Input Current	Zero sequence Input Current
	1 = Type 1	1 = 1A	1 = 1A
	2 = Type 2	2 = 5A	2 = 5A

The technical specifications reported are not binding and they should be agreed in the contract.

For further technical information on our products visit www.microelettrica.com

Microelettrica Scientifica S.p.A.

20090 Buccinasco (MI) , Via Lucania 2, Italy

Tel.: +39 02 575731

E-mail: info@microelettrica.com

www.microelettrica.com



KNORR-BREMSE

NEW YORK AIR BRAKE

IFE

MERAK

MICROELETTRICA

SELECTRON

KIEPE ELECTRIC

EVAC

ZELISKO

RAILSERVICES