



PROTECTION RELAYS

DTMR

Differential transformer relay

Three-phase percentage biased differential and Restricted Earth Fault protection relay for 2 winding transformers or 3 winding with only one source of supply. Two phase overcurrent plus earth fault relay with programmable time current curves suitable for protection of HV & MV transmission and distribution systems. The real time measurements of the primary values of the input quantities are continuously available on the relay's display as well as via the serial communication bus from the MCom interface program. Setting of the relay can be done either through Front face Keyboard or via serial communication bus from MCom interface program. Control of the associated circuit breaker can be done either from the relay keyboard or via serial communication bus from MCom interface program. Settings, events and oscillographic recordings are stored in a non-volatile memory (E2PROM).

Besides the normal Watchdog and Powerfail functions, a comprehensive program of self-test and self diagnostic provides:

- Diagnostic an functional test with checking of program routines and memory contents, run every time the auxiliary power is switched on.
- Dynamic functional test running during normal operation every 15 min.
- Complete Test activated by the keyboard or via the communication bus either with or without tripping of output relays.

Any internal fault detected is indicated by a fault message on the display and by deenergization of R5 relay.



MICROELETTRICA

Protective Functions

- F50/51 : Two phase fault levels (side 1 and side 2)
- F87T : Two phase differential level
- F87N/51N : Restricted earth fault (side 1 and side 2)
- F51BF : Breaker Failure protection

Measurements

- A,IB,IC : Current
- dA,dB,dC : Differential current
- 2H,5H : 2nd & 5th Harmonic detection current
- I_o : Neutral current

Recording

- Event Recording (last 100 events)
- Trip Recording (last 20 trips) complete with cause of tripping and values of the input quantities at the moment of trip
- Oscillographic recording of input quantities (8 channels, 32 sample/cycle, 3 sec each)

Control

- 6 Output Relays user programmable
- 4 Digital Inputs user programmable
- Blocking input and output for pilot wire selectivity coordination
- Time tagging resolution 1ms.
- Trip circuit supervision
- Associated Circuit Breaker control (OPEN / CLOSE)
- Breaker interruption energy $\Sigma i^2 t$
- Complete autodiagnostic program with dedicated relay
- 2 Setting programs
- Synchronization with other relays

Technical Characteristics

- Graphical Display (128x64 dot)
- 4 Leds for signalization
- Multilanguage Display (English/Italian standard, available - other on request)

Power Supply Ratings

- Autoranging multivoltage power supply
- Type 1 : 24V(-20%) / 110V(+15%) a.c. - 24V(-20%) / 125V(+20%) d.c.
- Type 2 : 80V(-20%) / 220V(+15%) a.c. - 90V(-20%) / 250V(+20%) d.c.

Communications

- 1 RS485 Serial communication port on rear side
- 1 RS232 Serial communication port on front panel
- Modbus RTU / IEC870-5-103 Communication Protocols
- Canbus port for external additional modules

Expansion Modules (optional)

- "UX10-4" 10 Digital Inputs and 4 Output Relays
- "14DI" 14 Digital Inputs
- "14DO" 14 Output Relays

Execution

- 2 Module box. (3 modules with 1 expansion, 4 modules with 2 expansion)
- IP44 protection case (on request IP54)
- Totally draw-out execution

Software

- MCom2 Program interface for device management


1 - F87T : Low-set Phase Differential

Current setting range	$1d > = (0.1 \div 0.5)I_n$	step 0.01I _n
Instantaneous output	$\leq 0.03s$	
Bias current selector	Longitudinal - Latitudinal side 1 - Latitudinal side 2	
Bias percentage	$R = (10 \div 50)\%$	step 1%
2nd Harmonic restraint level	$2H = (0.1 \div 0.5)$	step 0.01
5th Harmonic restraint level	$5H = (0.1 \div 0.5)$	step 0.01
Time during which harmonic restraint level can be lowered at transformer energisation	$tH = (0.01 \div 90)s$	step 0.01s
2nd Harmonic restraint level reduction during tH	$R2H = (0.1 \div 1.0)2H$	step 0.01
5th Harmonic restraint level reduction during tH	$R5H = (0.1 \div 1.0)5H$	step 0.01

$$I_R = \frac{I_1 + I_2 + I_3}{2} \text{ (Latitude)}$$

OR

$$I_R = \frac{I_1 + I_2}{2} \text{ (Longitude)}$$

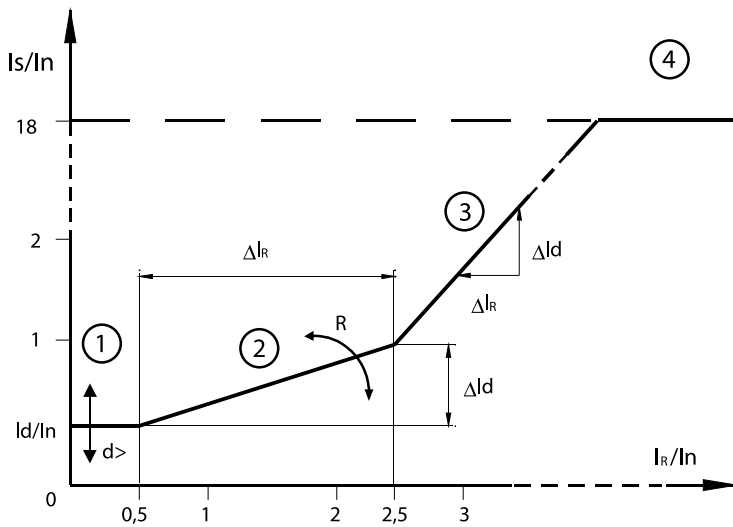

$$R\% = 100 \frac{\Delta I_d}{\Delta I_R}$$

$$\textcircled{1} \frac{I_s}{I_n} = \frac{I_d}{I_n}$$

$$\textcircled{2} \frac{I_s}{I_n} = \frac{I_d}{I_n} + \left(\frac{I_R}{I_n} - 0,5\right) \cdot \frac{R\%}{100}$$

$$\textcircled{3} \frac{I_s}{I_n} = \frac{I_d}{I_n} + \frac{2R\%}{100} + \left(\frac{I_R}{I_n} - 2,5\right)$$

$$\textcircled{4} \frac{I_s}{I_n} \cong 18$$

I_s = Effective relay's operation differential current

I_d = Relay set differential current = $[d]$

I_R = Relay's through current

2 - F87T : High-set Phase Differential

Current setting range	$2d > = (2 \div 20)I_n$	step 0.01 I_n
Detection time	$6ms < t < 20ms$	
Peak current detection with DC offset restraint		

F87N : Restricted Earth Fault - Side 1

Trip level	$1d_{o>} = (0.01 \div 4)I_n$	step 0.01 I_n
Instantaneous output	$\leq 0.03s$	
Trip time delayed element	$t1d_o = (0.02 \div 100)s$	step 0.01s
Element lock-out during tH	Bdo: ON-OFF	

F87N : Restricted Earth Fault - Side 2

Trip level	$2d_{o>} = (0.01 \div 4)I_n$	step 0.01 I_n
Instantaneous output	$\leq 0.03s$	
Trip time delayed element	$t2d_o = (0.02 \div 100)s$	step 0.01s
Element lock-out during tH	Bdo: ON-OFF	

1F - 50/51 (1I>): First Overcurrent Element - Side 1


Current setting range	$1I > = (0.1 \div 4)I_n$	step 0.01 I_n
Definite trip time delay	$t1I > = (0.02 \div 100)s$	step 0.01s
Instantaneous output	$\leq 0.03s$	
Time current curves	Indep.Definite Time (D), IEC (A / B / C), IEEE (MI / VI / I / EI / SI)	

2F - 50/51 (1I>>): Second Overcurrent Element - Side 1

Current setting range	$1I >> = (0.1 \div 20)I_n$	step 0.01 I_n
Definite trip time delay	$t1I >> = (0.02 \div 100)s$	step 0.01s
Instantaneous output	$\leq 0.03s$	
Automatic doubling of level 1I>> on inrush	$1I >>x2 = ON/OFF$	

1F - 50/51 (2I>): First Overcurrent Element - Side 2		
Current setting range	$2I> = (0.1 \div 4)I_n$	step 0.01I _n
Definite trip time delay	$t2I> = (0.02 \div 100)s$	step 0.01s
Instantaneous output	$\leq 0.03s$	step 0.01I _n
Time current curves	Indep.Definite Time (D), IEC (A / B / C), IEEE (MI / VI / I / EI / SI).	
2F - 50/51 (2I>>): Second Overcurrent Element - Side 2		
Current setting range	$2I>> = (0.1 \div 20)I_n$	step 0.01I _n
Definite trip time delay	$t2I>> = (0.02 \div 100)s$	step 0.01s
Instantaneous output	$\leq 0.03s$	
Automatic doubling of level 1I>> on inrush	$2I>>x2 = ON/OFF$	
1F - (Wi): Circuit Breaker Energy Maintenance		
Conventional interruption current	$I_i = (0.1 \div 99)I_n$	step 0.1I _n
Max Energy before maintenance	$W_i = (1 \div 9999)$	step 1
Trip Circuit Supervision Element		
Independent time delay	$t_s = (0.1 \div 100)s$	step 0.01s
Trip circuit voltage	$= (24 \div 250)V_{dc}$	
Breaker Failure Element		
Trip time delay	$t_{BF} = (0.05 \div 0.75)s$	step 0.01s

Connection Diagram

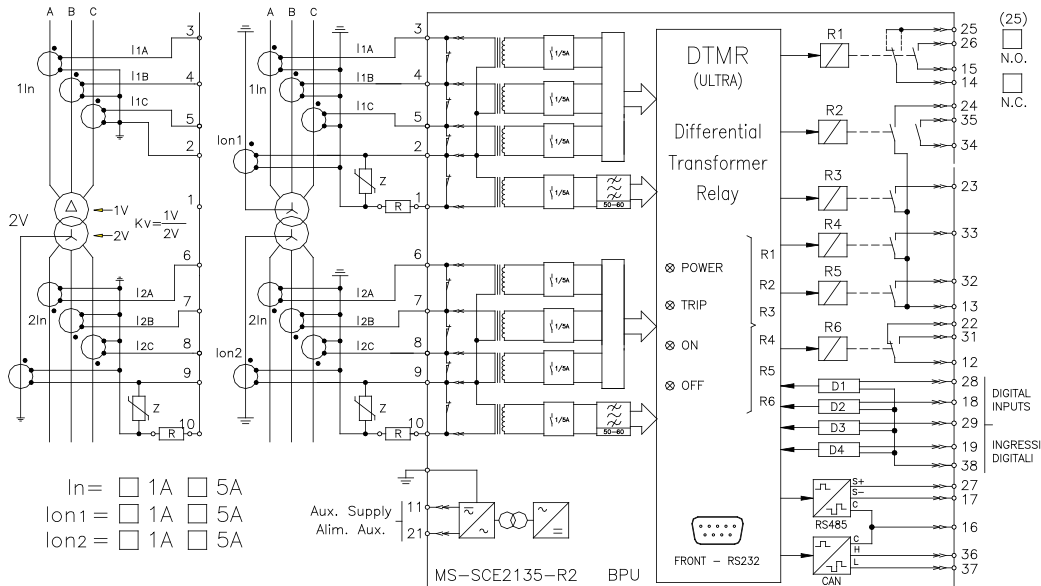

Typical Characteristics

Accuracy at reference value of influencing factors	1% In - 0.1% On	for measure
	1% +/- 10ms	for times
Rated Current	In = 1 or 5A - On = 1 or 5A	
Current overload	80 In for 1 sec; 4 In continuous	
Burden on current inputs	Phase : 0.01VA at In = 1A; 0.2VA at In = 5A Neutral : 0.01VA at In = 1A ; 0.2VA at In = 5A	
Rated Voltage	Un = 100 ÷ 125V	
Voltage Overload	2Un continuous	
Burden on voltage input	0.1 VA at Un	
Average power supply consumption	<10 VA	
Output Relays	rating 5 A; Vn = 380 V A.C. resistive switching = 1100W (380V max) make= 30 A (peak) 0.5 sec. break = 0.3 A, 110 Vcc, L/R = 40 ms (100.000 op.)	

Order Code - Example

DTMR	1	2	1	1	1	2
	Power Supply	Phase Rated	Neutral Rated	Configuration	1 st Expansion	2 nd Expansion
		Input Current	Input Current	R1 (14-25)	module	module
	1 = Type 1	1 = 1A	1 = 1A	1 = N.O.	1 = None	1 = None
	2 = Type 2	2 = 5A	2 = 5A	2 = N.C.	2 = UX10-4	2 = UX10-4
					3 = 14DI	3 = 14DI
					4 = 14DO	4 = 14DO

The technical specifications reported are not binding and they should be agreed in the contract.

For further technical information on our products visit www.microelettrica.com

Microelettrica Scientifica S.p.A.

20090 Buccinasco (MI) , Via Lucania 2, Italy

Tel.: +39 02 575731

E-mail: info@microelettrica.com

www.microelettrica.com



KNORR-BREMSE

SELECTRON

NEW YORK AIR BRAKE

KIEPE ELECTRIC

IFE

EVAC

MERAK

ZELISKO

MICROELETTRICA

RAILSERVICES