



PROTECTION RELAYS

U-MLEs-PLs-Ts

DC substation protective relay (double voltage line test) 32, 45, 49, 64, 76, 79, 80

D.C. Feeder protection relay with setting parameters programmable locally or via serial communication. Suitable for protection of D.C. feeders with High-Speed DC Breakers, for railway application.

The relay measures the Line current and voltage through one current transducer and one voltage transducer.

The transducers (type MHCO and MHIT) are galvanically insulated.

Via fiber optic and have the following measuring ranges:

- Line voltage : $(0 \div 2)V_n$
- Line current : $(0 \div 10)I_n$
- Insulation voltage 20kVac 1min.

Real time measurements of primary input values can be read continuously both from the display and via ports communication.

Relay settings can be done via the front Touch Panel (or USB 2.0 port) and via rear serial communication.

The associated Circuit Breaker can be controlled via the frontal keyboard (or USB 2.0 port) and via serial communication.

Settings, events and oscillographic recordings are stored in a non-volatile memory (E²PROM).



MICROELETTRICA

Besides the normal Watchdog and Powerfail functions, a comprehensive program of self-test and self diagnostic provides:

- Diagnostic and functional test with checking of program routines and memory contents, running every time the auxiliary power supply is switched on.
- Dynamic functional test running during normal operation.
- Complete Test activated by the keyboard or via the communication bus.

Any internal fault detected is indicated by a fault message on the display and by de-energization of associated I.R.F. output relay.

The relay is available in three different executions:

- Flush mounting.
- Surface mounting.
- 19" Rack mounting.

Protective Functions

- Thermal image protection of the Cable/Line
- 4 Overcurrent levels Forward/Reverse programmable
- 2 Current Step level with di/dt dependance
- 2 Rate of rise level
- 1 Impedance monitoring level with di/dt dependance
- 1 Current monitoring level with di/dt dependence
- 2 Frame Fault Current and Voltage monitoring levels
- 4 Shot Automatic Reclosure
- 2 Overvoltage levels
- 2 Undervoltage levels
- Automatic programmable Line Test
- Energy counter pulse
- C/B Lock
- Remote Trip

Control

- Trip circuit supervision
- Associated Circuit Breaker control (OPEN / CLOSE)
- Breaker failure protection
- Breaker interruption energy $\Sigma i^2 t$

Recording

- Two complete setting programs switchable locally or remotely
- Blocking input and Blocking output for pilot wire selectivity coordination and intertripping schemes
- Event Recording (last 100 events)
- Trip Recording (last 10 trips) complete with cause of tripping and values of the input quantities at the moment of trip
- Oscillographic recording of input quantities

Communications

- Modbus RTU (TCP-IP) and IEC870-5-103 communication protocols
- USB 2.0 on Front Face
- RS485 or RJ45 (optional) communication port on Back Panel
- Synchronisation with other relays (resolution 1 ms)
- CanBus line for control of slave I/O Expansion modules

Technical Characteristics

- Graphic Display 4.3" (480x262 dots)
- 10 LEDs for: Power on/internal relay fault, Trip / alarm, Trip circuit fault
- 6 Output relays totally user programmable
- 4 Digital inputs user programmable

Mounting

- 2 Module box, totally draw-out execution
- IP44 protection case (on request IP54)
- Totally draw-out execution

Power Supply Ratings

- Type 1 : 24V(-20%) / 110V(+15%) a.c. - 24V(-20%) / 125V(+20%) d.c.
- Type 2 : 80V(-20%) / 220V(+15%) a.c. - 90V(-20%) / 250V(+20%) d.c.

Software

- MCom2 Program interface for device management

Accessories

- High-Voltage Current/Voltage measuring Transducer with Fiber Optic output : Type MHCO-T-V-I
- High-Voltage Current measuring Transducer with Fiber Optic output : Type MHCO-T-I.
- High-Voltage Voltage measuring Transducer with Fiber Optic output : Type MHCO-T-V
- Voltage measuring receiver with fiber optic input and 3 Analogic outputs : Type MHCO-R-V
- Current measuring receiver with fiber optic input and 3 Analogic outputs: Type MHCO-R-I
- Input/Output Expansion Module: UX10-4 - 10 Digital Inputs + 4 Outputs Relay
UX14DI - 14 Digital Inputs
UX14DO - 14 Outputs Relay
- Cable monitoring system MSG/N-DIN independent tripping and measurement
- Cable Screen-to-Ground and Conductor-to-Screen monitoring
- Two-channels Digital/Fiber Optic converter for remote intertripping signal Type CFV-BL
- Line Test Contactor
- Line Test Resistor
- Rail Earthing Contactor
- Other protection Relay
- SCADA and Communication systems

Real Time Measurements

I = Current V = Voltage P = Power +Wh, = Exported Energy -Wh, = Imported Energy

F49 (T>): Thermal Image element with prealarm

Function enabling	Disable / Enable	
Temperature prealarm	Tal = (10 ÷ 100)%Tn	step 1%Tn
Continuous admissible current	Is = (0.5 ÷ 1.5)	step 0.01
Time constant	Kt = (1 ÷ 600)min	step 0.01min

1F - 67/50/51 (1I>): 1st Overcurrent Element

Function enabling	Disable / Enable	
Time current curves	f(t) = Indep.Definite Time (D), IEC (A/B/C)	
Operation Mode	f(a) = Non Directional - Directional Forward - Directional Reverse	
Setting range	Is = (0.1 ÷ 4)In	step 0.01In
Instantaneous output	≤0.03s	
Independent time delay	ts = (0.02 ÷ 100)s	step 0.01s

2F - 67/50/51 (2I>): 2nd Overcurrent Element

Function enabling	Disable / Enable	
Time current curves	f(t) = Indep.Definite Time (D), IEC (A/B/C)	
Operation Mode	f(a) = Non Directional - Directional Forward - Directional Reverse	
Setting range	Is = (0.1 ÷ 4)In	step 0.01In
Instantaneous output	≤0.03s	
Independent time delay	ts = (0.02 ÷ 100)s	step 0.01s

3F - 67/50/51 (3I>): 3rd Overcurrent Element

Function enabling	Disable / Enable	
Operation Mode	f(a) = Non Directional - Directional Forward - Directional Reverse	
Setting range	Is = (0.1 ÷ 10)In	step 0.01In
Instantaneous output	≤0.03s	step 0.01In
Independent time delay	ts = (0.02 ÷ 100)s	step 0.01s

4F - 67/50/51 (4I>): 4th Overcurrent Element

Function enabling	Disable / Enable	
Operation Mode	f(a) = Non Directional - Directional Forward - Directional Reverse	
Setting range	Is = (0.1 ÷ 10)In	step 0.01In
Instantaneous output	≤0.03s	
Independent time delay	ts = (0.02 ÷ 100)s	step 0.01s

1F - (1ΔI): 1st 1DI Element

Function enabling	Disable / Enable	
Setting range	DI = (100 ÷ 9990)A	step 10A
Minimum di/dt level to start ΔI	di = (4 ÷ 400)A/ms	step 1A/ms
Instantaneous output	≤0.03s	
Independent time delay	tDI = (0 ÷ 500)ms	step 1ms
Detection reset time delay	tDI = (0 ÷ 100)ms	step 1ms

2F - (2ΔI): 2st 2DI Element

Function enabling	Disable / Enable	
Setting range	DI = (100 ÷ 9990)A	step 10A
Minimum di/dt level to start ΔI	di = (4 ÷ 400)A/ms	step 1A/ms
Instantaneous output	≤0.03s	
Independent time delay	tDI = (0 ÷ 500)ms	step 1ms
Detection reset time delay	tDI = (0 ÷ 100)ms	step 1ms

1F - (1 di/dt): 1st Current Rate of Rise Element

Function enabling	Disable / Enable	
Setting range	$G = (4 \div 400)A/ms$	step 1A/ms
Instantaneous output	$\leq 0.03s$	
Independent time delay	$tG = (2 \div 500)ms$	step 1ms

2F - (2 di/dt): 2nd Current Rate of Rise Element

Function enabling	Disable / Enable	
Setting range	$G = (4 \div 400)A/ms$	step 1A/ms
Instantaneous output	$\leq 0.03s$	
Independent time delay	$tG = (2 \div 500)ms$	step 1ms

Rapp: Impedance monitoring with di/dt dependence

Function enabling	Disable / Enable	
Arc Voltage	$V_a = (0 \div 800)V$	step 1V
Internal Resistance	$R_i = (0 \div 0.250)\Omega$	step 0.0010
Total Resistance of the circuit	$R_t = (0.001 \div 2.5)\Omega$	step 0.0010
Internal Inductance	$L_i = (0.001 \div 0.01)H$	step 0.001H
Total Inductance of the circuit	$L_t = (0.002 \div 0.05)H$	step 0.001H
Resistance trip level	$R^* = (0 \div 100)\Omega$	step 0.010
Limit value of di/dt	$g = (10 \div 500)A/ms$	step 1A/ms
Instantaneous output	$\leq 0.03s$	
Independent time delay	$g = (0 \div 100)ms$	step 1ms

Iapp: Current monitoring with di/dt dependence

Function enabling	Disable / Enable	
Current trip level when di/dt = 0	$I_a = (500 \div 5000)A$	step 10A
Current trip level when di/dt $\geq [g]$	$I^* = (400 \div 1500)A$	step 10A
Limit value of di/dt	$g = (30 \div 500)A/ms$	step 1A/ms
Drop-out percentage	$Res = (80 \div 100)\%I_{app}$	step 1%I _{app}
Instantaneous output	$\leq 0.03s$	
Independent time delay	$t_r = (0 \div 5)s$	step 0.01s

1F - 64 (1 Ig): 1st Frame Fault Element

Function enabling	Disable / Enable	
Time current curves	$f(t) = \text{Indep. Definite Time (D), IEC (A/B/C)}$	
Current setting range	$I_s = (0.1 \div 4)I_{gn}$	step 0.01I _{gn}
Voltage setting range	$U_s = (0.01 \div 1)U_{gn}$	step 0.01U _{gn}
Instantaneous output	$\leq 0.03s$	step 1%I _{app}
Independent time delay	$t_s = (0.02 \div 100)s$	step 0.01s

2F - 64 (2 Ig): 2nd Frame Fault Element

Function enabling	Disable / Enable	
Time current curves	$f(t) = \text{Indep. Definite Time (D), IEC (A/B/C)}$	
Current setting range	$I_s = (0.1 \div 4)I_{gn}$	step 0.01I _{gn}
Voltage setting range	$U_s = (0.01 \div 1)U_{gn}$	step 0.01U _{gn}
Instantaneous output	$\leq 0.03s$	step 1%I _{app}
Independent time delay	$t_s = (0.02 \div 100)s$	step 0.01s


RS-G: Cable insulation (Screen-Ground)

Function enabling	Disable / Enable	
Setting range	$RL-S = (100 \div 5000)\Omega$	step 100 Ω
Instantaneous output	$\leq 0.03s$	
Independent time delay	$t_{RL-S} = (0.05 \div 100)s$	step 0.01s

RCL: Automatic Reclosure		
Function enabling	Disable / Enable	
Number of Reclosure	ShN° = 1 / 2 / 3 / 4	
Reclaim time	$t_r = (1 \div 200)s$	step 1s
Time first reclosure	$t_1 = (0.1 \div 1000)s$	step 0.1s
Time second reclosure	$t_2 = (0.1 \div 1000)s$	step 0.1s
Time third reclosure	$t_3 = (0.1 \div 1000)s$	step 0.1s
Time fourth reclosure	$t_4 = (0.1 \div 1000)s$	step 0.1s
LT: Automatic Line Test (Double Voltage Line test)		
Function enabling	Disable / Enable	
Number of Test	TestN° = 0 / 2 / 3 / 4	
Minimum residual voltage	$VR < = (0 \div 1)V_n$	step 0.1Vn
Minimum residual resistance	$RR < = (0 \div 500)\Omega$	step 1 Ω
Minimum line voltage	$V_{Fast} = (0.5 \div 1)V_n$	step 0.1Vn
Waiting time after C/B closing	$t_p = (0 \div 30)s$	step 1s
Duation of the Line Test	$t_t = (1 \div 10)s$	step 1s
Wait time between 2 consecutive tests	$t_{cy} = (1 \div 60)s$	step 1s
Wait time to start recl.after succes fine test	$t_w = (0 \div 10)s$	step 1s
1F - 59 (1U>): 1st Overvoltage Element		
Function enabling	Disable / Enable	
Setting range	$U_s = (0.5 \div 1.5)U_n$	step 0.01Un
Instantaneous output	$\leq 0.03s$	
Independent time delay	$t_s = (0 \div 650)s$	step 1s
2F - 59 (2U>): 2nd Overvoltage Element		
Function enabling	Disable / Enable	
Setting range	$U_s = (0.5 \div 1.5)U_n$	step 0.01Un
Instantaneous output	$\leq 0.03s$	
Independent time delay	$t_s = (0 \div 650)s$	step 1s
1F - 27 (1U<): 1st Undervoltage Element		
Function enabling	Disable / Enable	
Setting range	$U_s = (0.2 \div 1)U_n$	step 0.01Un
Instantaneous output	$\leq 0.03s$	
Independent time delay	$t_s = (0 \div 650)s$	step 1s
1F - 27 (2U<): 2nd Undervoltage Element		
Function enabling	Disable / Enable	
Setting range	$U_s = (0.2 \div 1)U_n$	step 0.01Un
Instantaneous output	$\leq 0.03s$	
Independent time delay	$t_s = (0 \div 650)s$	step 1s
Wi: Circuit Breaker Energy Maintenance		
Function enabling	Disable / Enable	
Setting range	$I_i = (0.1 \div 99)I_n$	step 0.1In
Conventional interruption current	$W_i = (1 \div 9999)$	step 1
RT: Remote Trip		
Function enabling	Disable / Enable	
Independent time delay	$t_s = (0 \div 10)s$	step 0.01s

Wh: Energy Counter Pulse		
Function enabling	Disable / Enable	
Energy level	WpP = (10 ÷ 1000)kW	step 10kW
Pulse duration	Pulse = (0.1 ÷ 2)s	step 0.01s
CB-L: C/B Lock		
Function enabling	Disable / Enable	
Breaker Failure Element		
Trip time delay	tBF = (0.05 ÷ 0.75)s	step 0.01s

U-MLEs-PLs-Ts (Example with MHIT Transducer)

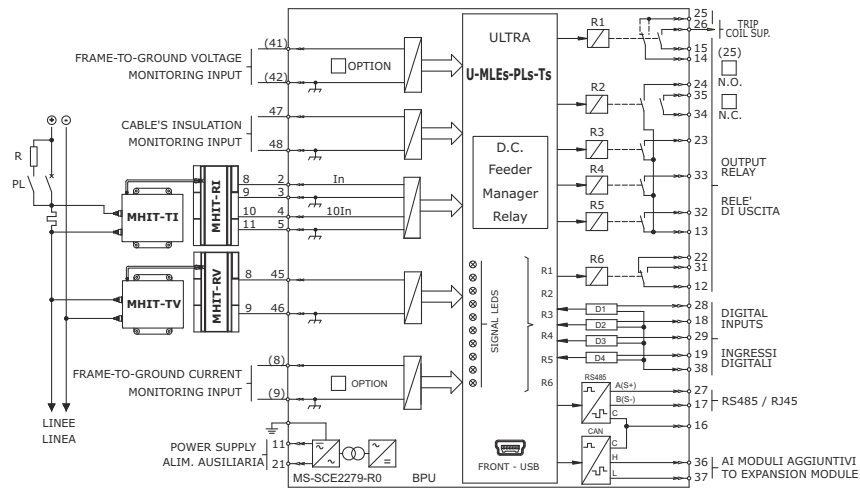

Typical Characteristics					
Accuracy at reference value of influencing factors	1% FS	for measurements			
	2% +/- 10ms	for times			
Burden on current inputs	0 ÷ 20 mA				
Neutral: 0.03VA at In=1A; 0.2VA at In=5A	<10 VA				
Output Relays	rating 5 A; Vn = 380 V A.C. resistive switching = 1100W (380V max) make= 30 A (peak) 0.5 sec., break = 0.3 A, 110 Vcc, L/R = 40 ms (100.000 op.)				
Order Code - Example					
U-MLEs-PLv	1	2	1	1	1
	Power Supply	Configuration	1 st Expansion	2 nd Expansion	Communication Protocol
		R1 (14-25)	module	module	
	1 = Type 1	1 = N.O.	1 = None	1 = None	1 = ModbusRTU (standard)
	2 = Type 2	2 = N.C.	2 = UX10-4	2 = UX10-4	2 = Modbus TCP-IP
			3 = 14DI	3 = 14DI	3 = IEC61850
			4 = 14DO	4 = 14DO	

The technical specifications reported are not binding and they should be agreed in the contract.

For further technical information on our products visit www.microelettrica.com

Microelettrica Scientifica S.p.A.

20090 Buccinasco (MI) , Via Lucania 2, Italy
Tel.: +39 02 575731
E-mail: info@microelettrica.com
www.microelettrica.com

